



PRIBLIŽEVANJE IN KRIŽANJE TK CEVI-KABLA IN ELEKTROENERGETSKIH VODOV

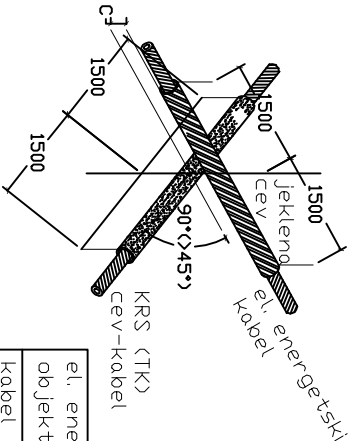

el. energetski objekt	napetost pritisk	C (mm)
kabel	do 250 V	300
kabel	< 250 V	500

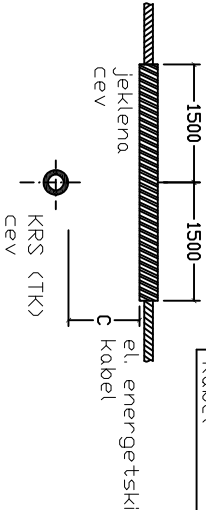


OPOMBA: vzporedni poteki v istem jarku nisu dovoljeni



jambor daljinovoda

el. energetski objekt	napetost pritisk	A (mm)	B (mm)
kabel	do 10 kV	500	
kabel	< 10 kV	1000	
jambor daljinovoda	do 110 kV		10000
jambor daljinovoda	220 kV		15000
jambor daljinovoda	380 kV		25000
jambor daljinovoda v naselju	35 kV		1000

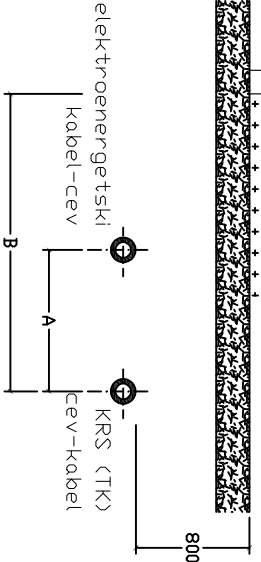

ENOPOLNA SHEMA	Projekt:	Dat:	junij 2020	IZVAJALEC:	Stevilka projekta:	List številka:
PRIBLIŽEVANJE IN KRIŽANJE TK CEVI-KABLA IN ENER. VODOV	CESTNA RAZSVETLJAVNA STRMCA	Risad		RCI d.o.o.	E1140/2020	E.1.13
		Pod				